Fitting A TSV1 to a Woodwarm Boilered Stove

Two Pipe System

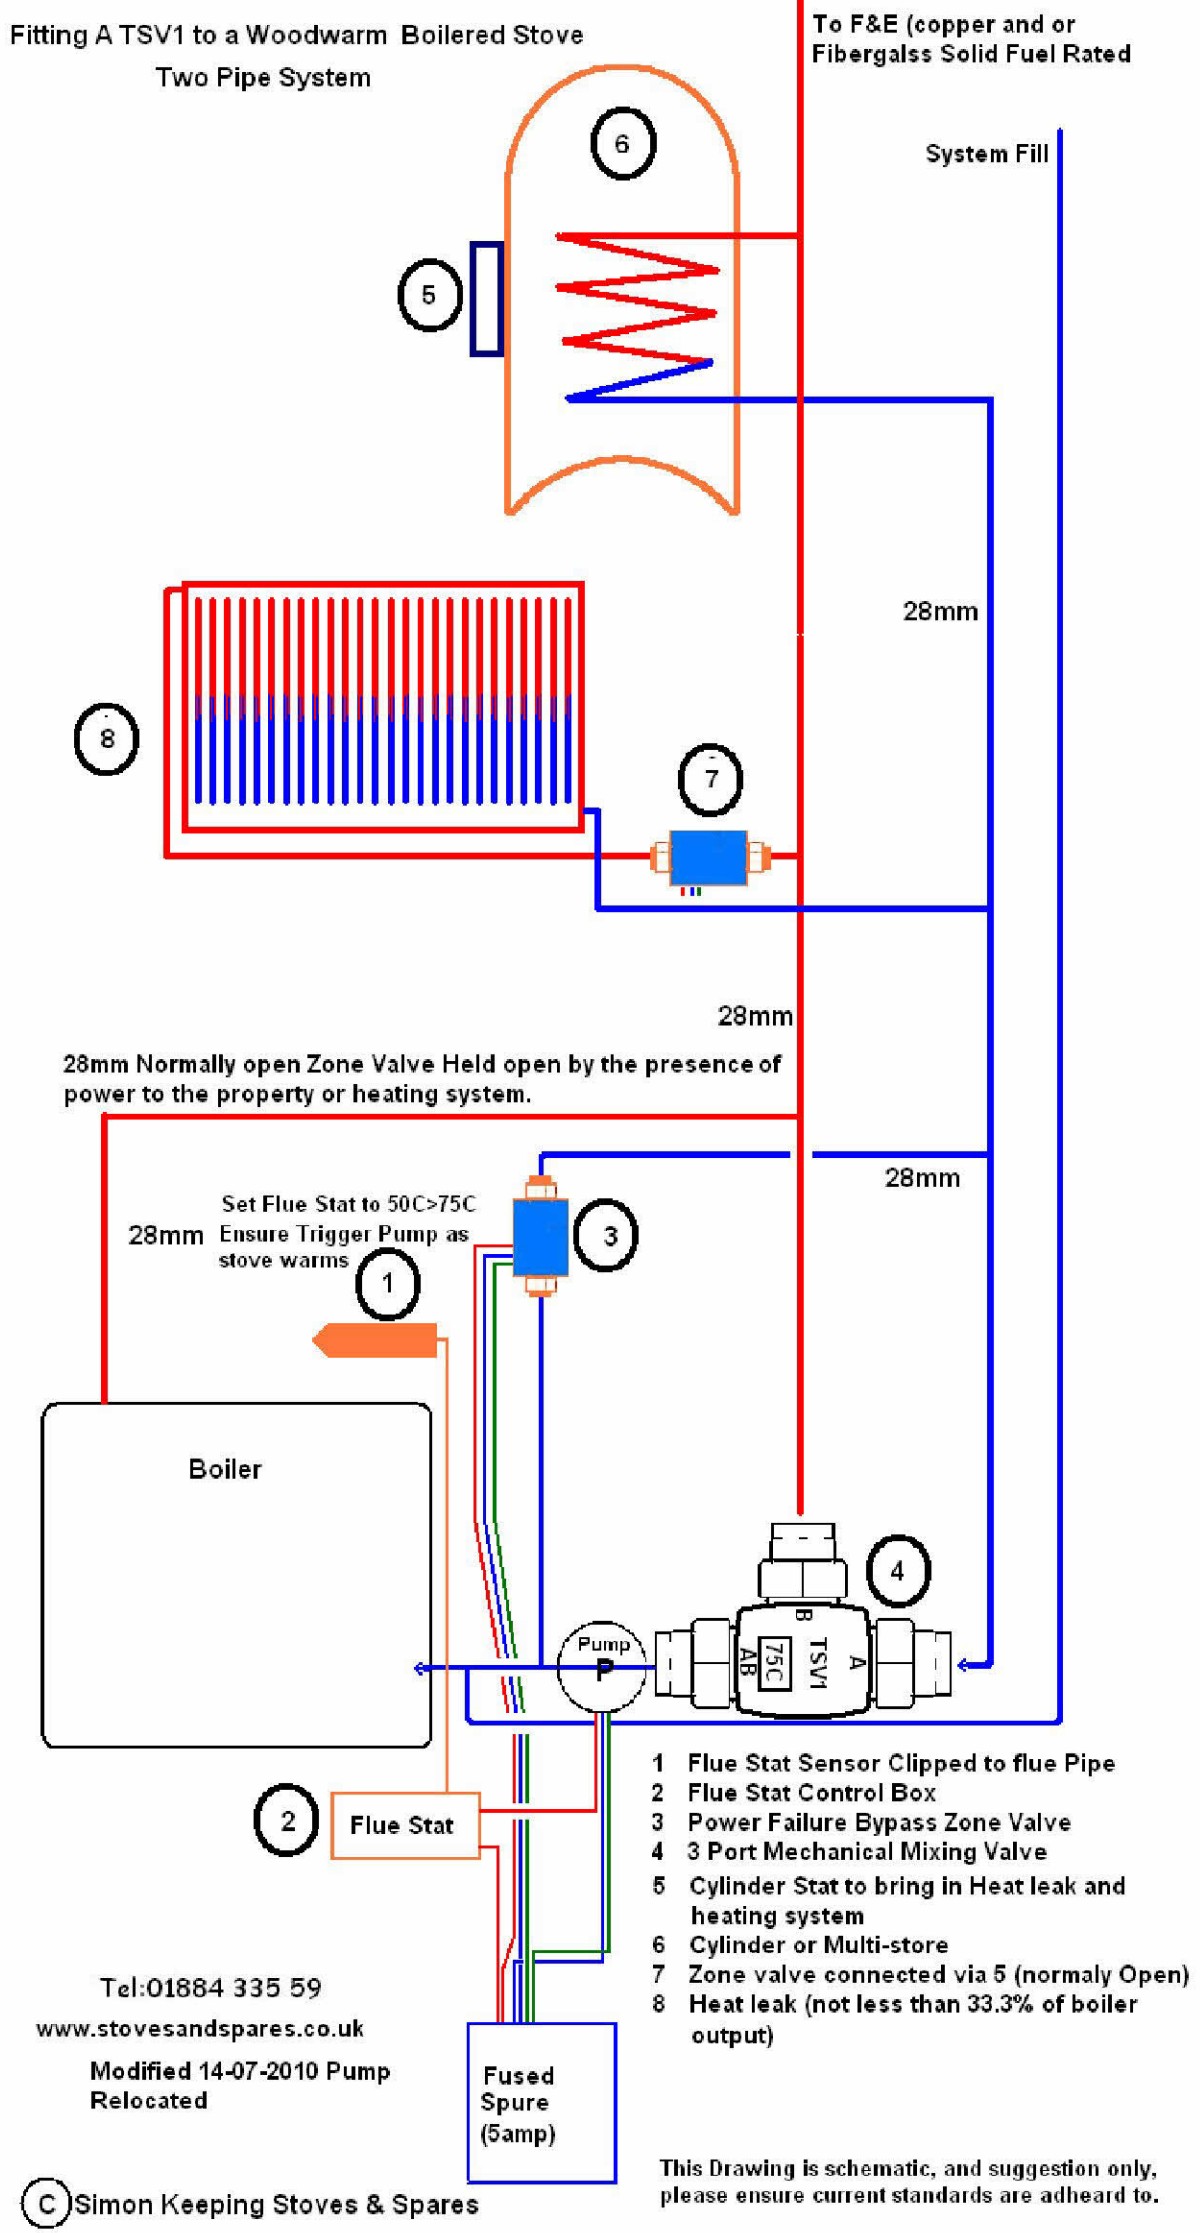

1 Flue Stat Sensor Clipped to flue Pipe
2 Flue Stat Control Box
3 Power Failure Bypass Zone Valve
4 3 Port Mechanical Mixing Valve
5 Cylinder Stat to bring in Heat leak and heating system
6 Cylinder or Multi-store
7 Zone valve connected via 5 (normaly Open)
8 Heat leak (not less than 33.3% of boiler output)

Tel:01884 335 59

www.stovesandspares.co.uk

Modified 14-07-2010 Pump Relocated

This Drawing is schematic, and suggestion only, please ensure current standards are adheard to.

© Simon Keeping Stoves & Spares